
Righteous Research

PO Box 582
Kahului, HI 96733

krause analytical

COC# 145981
Lab # 215272
Date Rec'd 10/5/2026
Report Issued 10/23/2026

Certificate of Analysis

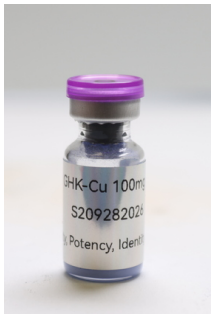

Project
Compound GHK-Cu
Label Claim 100 mg
Batch/Lot S209282026

Analyte	Result	Units	LOQ	% of Label	Method	Date	CAS
Peptides & Bioactives							
Chromatographic purity	>99.9	%	1		HPLC-UV/MS	10/15/2026	
GHK-Cu	80.1	mg	.1	80.1	HPLC-UV-MS	10/15/2026	89030-95-5
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/15/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,


Mark C. Krause
Laboratory Director


****

CHROMATOGRAM

****

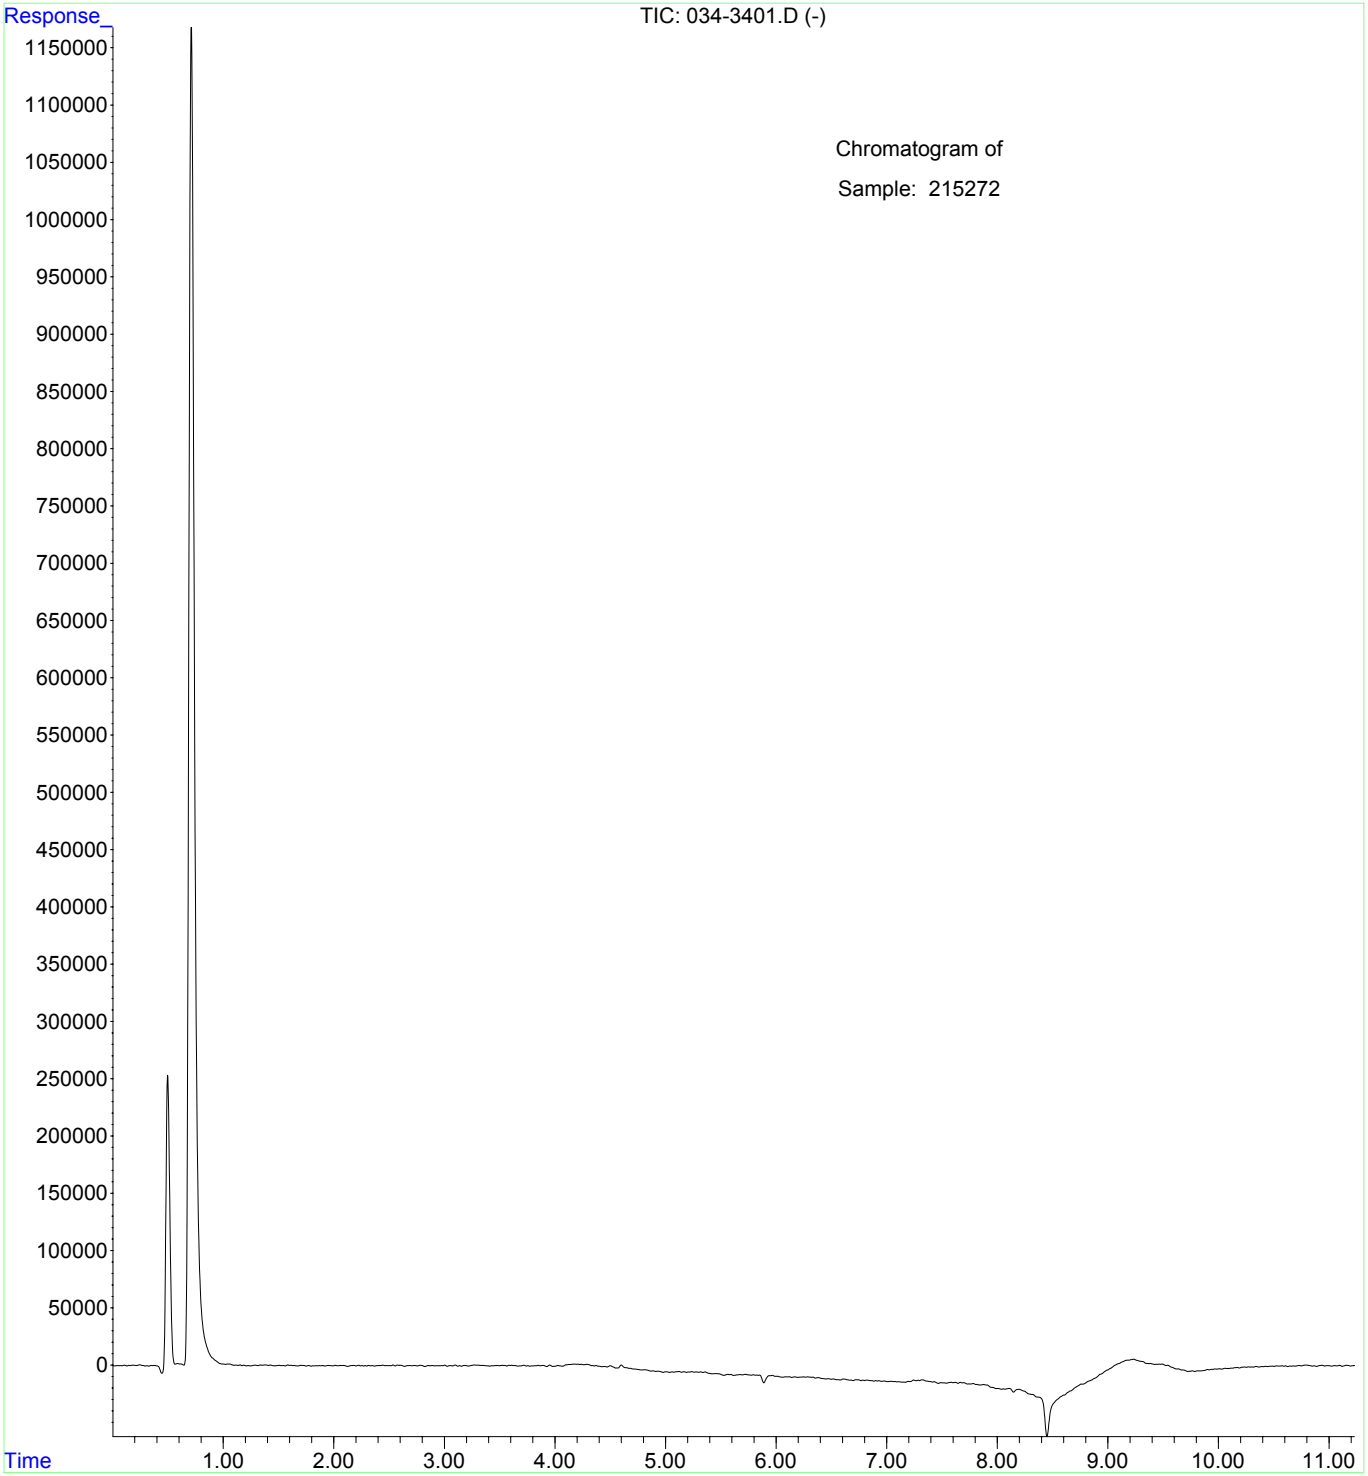

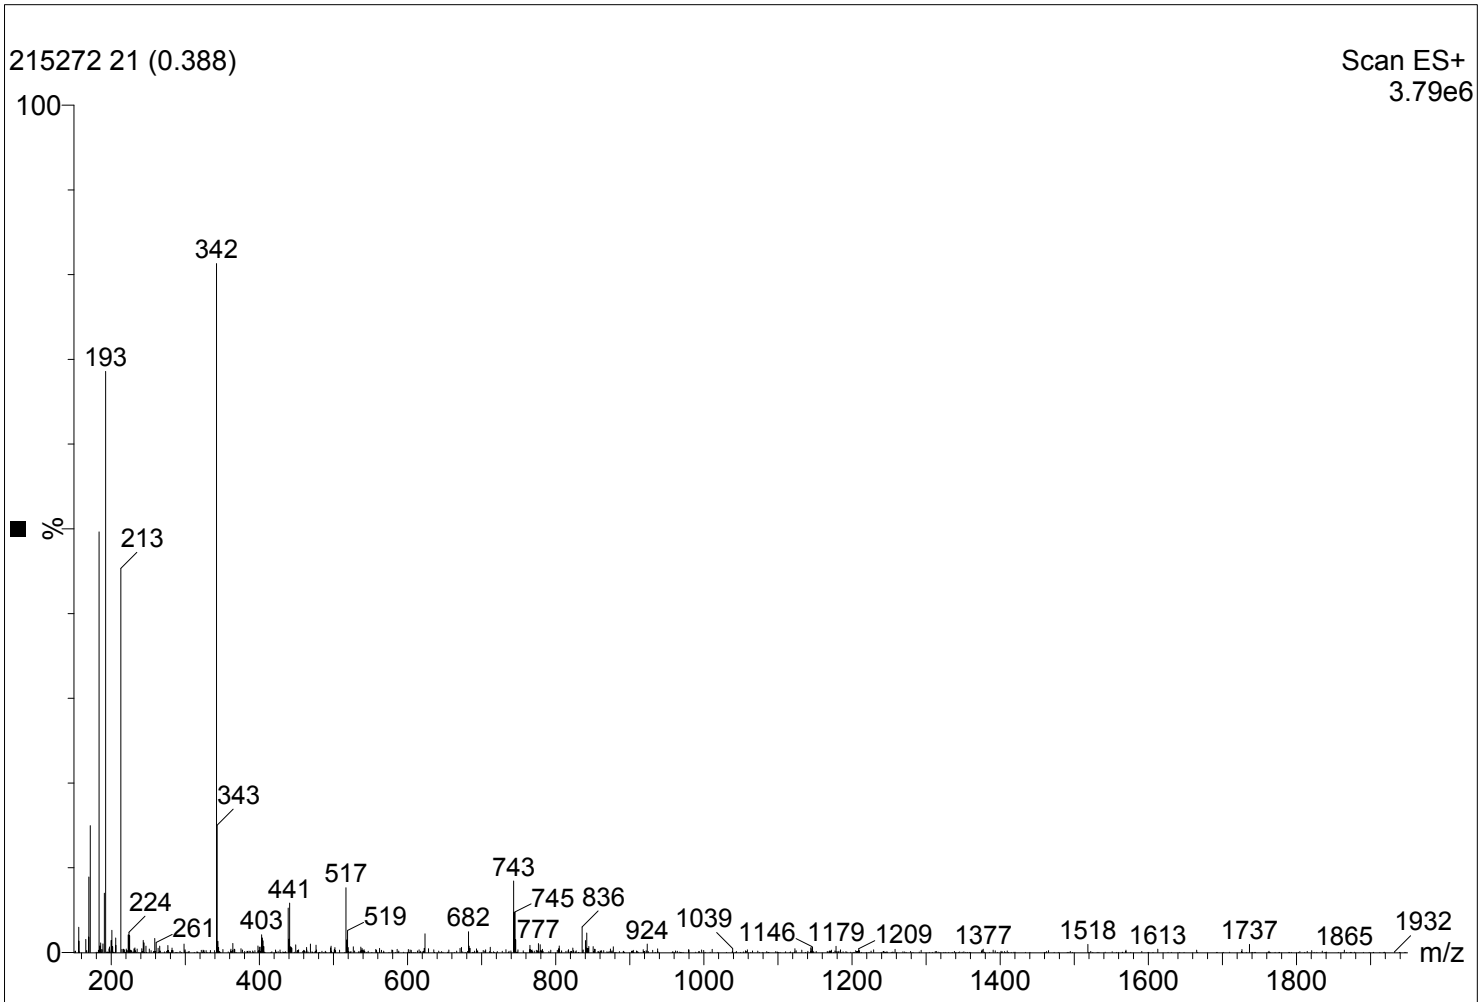
215272 21 (0.388)
Scan ES+
3.79e6
100
%
0
342
193
213
343
224
261
403
441
517
519
682
743
745
777
836
924
1039
1146
1179
1209
1377
1518
1613
1737
1865
1932
m/z
200
400
600
800
1000
1200
1400
1600
1800

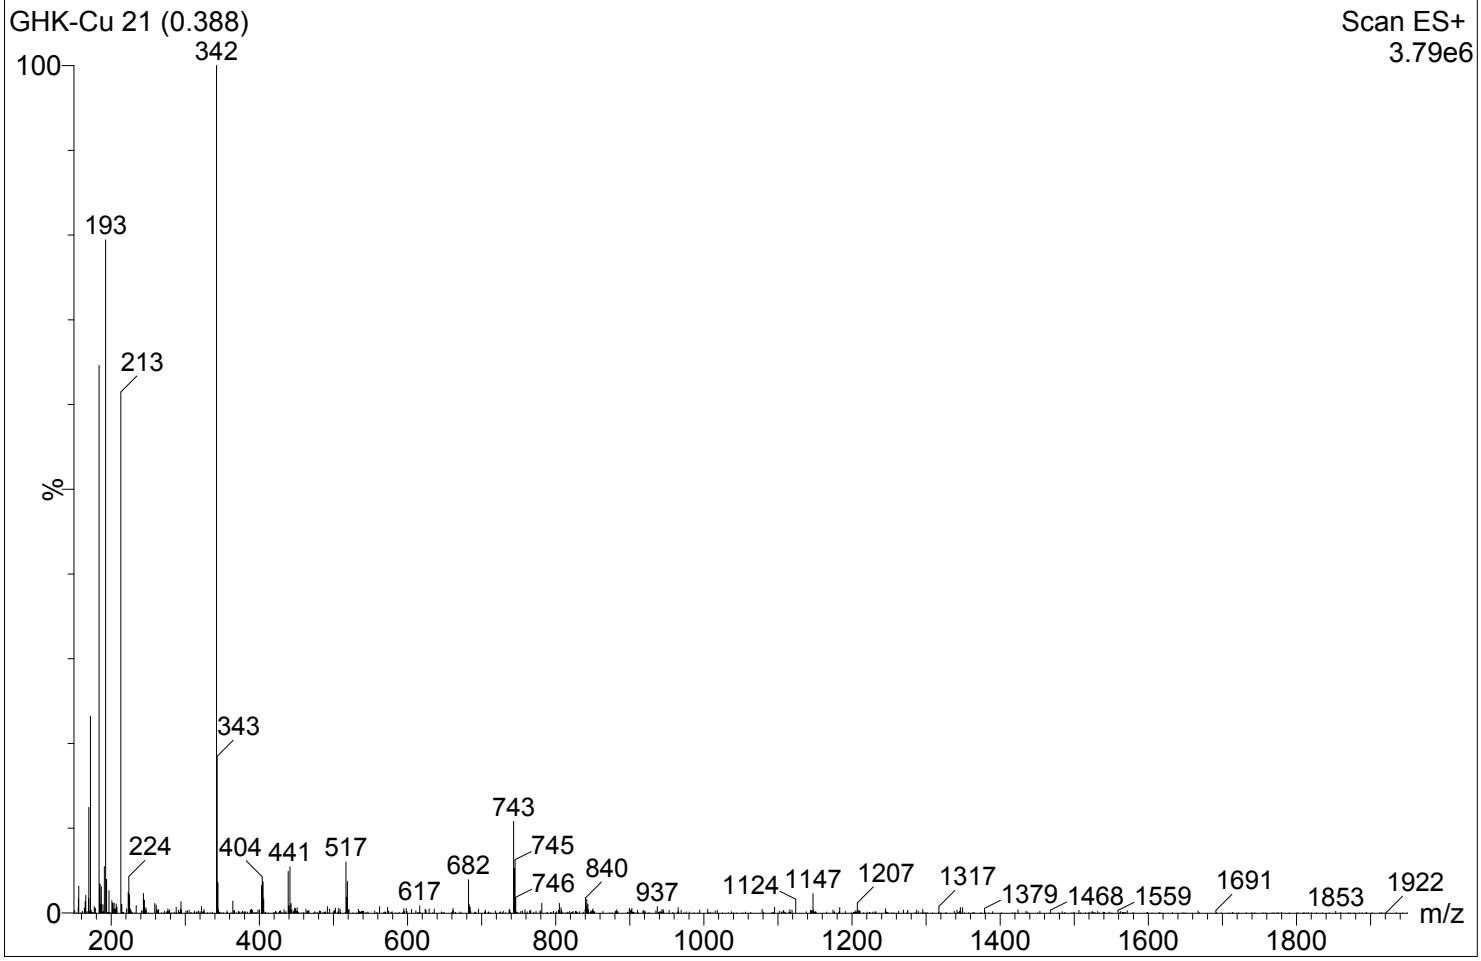
GHK-Cu 21 (0.388)
Scan ES+
3.79e6
100
%
0
342
193
213
343
224
404
441
517
617
682
743
745
746
840
937
1124
1147
1207
1317
1379
1468
1559
1691
1853
1922
m/z
200
400
600
800
1000
1200
1400
1600
1800