
Righteous Research

PO Box 582
Kahului, HI 96733

COC# 145981
Lab # 215271
Date Rec'd 10/5/2026
Report Issued 10/13/2026

Certificate of Analysis

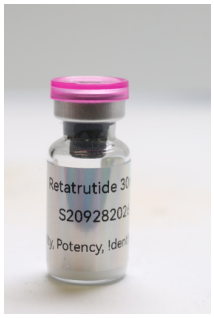

Project
Compound Retatrutide
Label Claim 30 mg
Batch/Lot S209282026

Analyte	Result	Units	LOQ	% of Label	Method	Date	CAS
Peptides & Bioactives							
Chromatographic purity	98.2	%	1		HPLC-UV/MS	10/10/2026	
Retatrutide	25.5	mg	.1	85.1	HPLC-UV-MS	10/10/2026	2381089-83-2
Mass Spectral Match	ID Confirmed				HPLC-UV-MS	10/10/2026	

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,


Mark C. Krause
Laboratory Director


****

CHROMATOGRAM

****

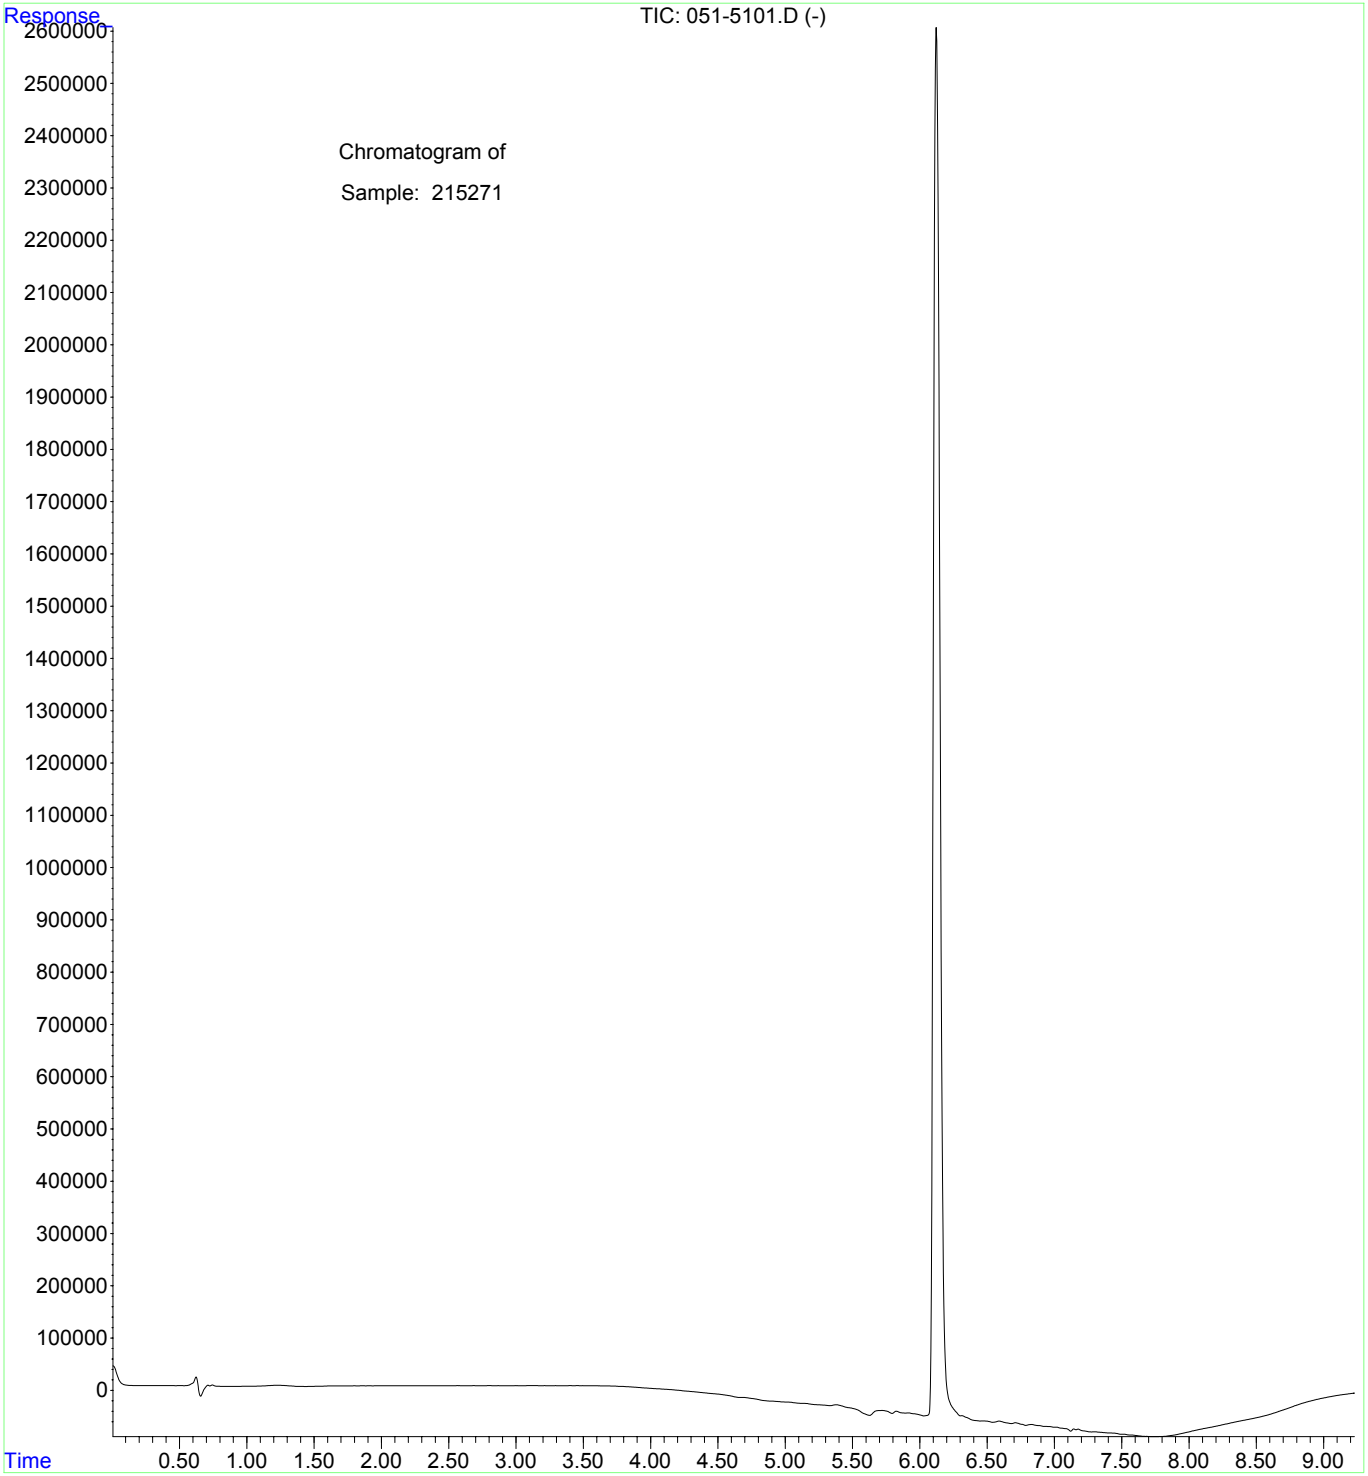

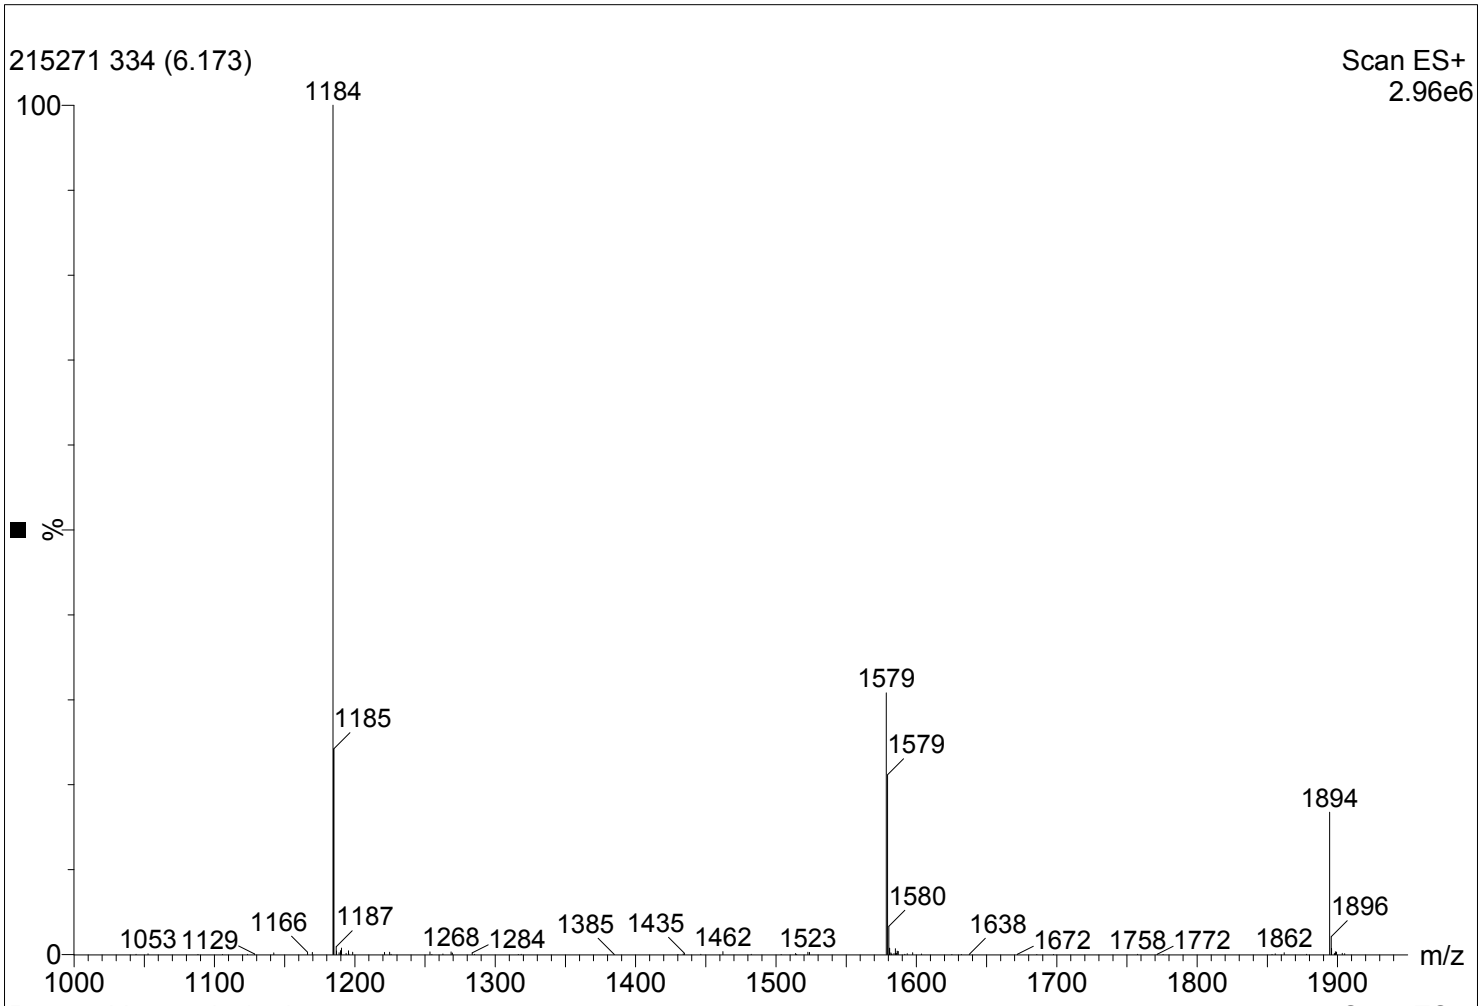
215271 334 (6.173)
Scan ES+
2.96e6
100
%
0
1184
1185
1579
1579
1894
1580
1896
1053
1129
1166
1187
1268
1284
1385
1435
1462
1523
1638
1672
1758
1772
1862
1000
1100
1200
1300
1400
1500
1600
1700
1800
1900
m/z

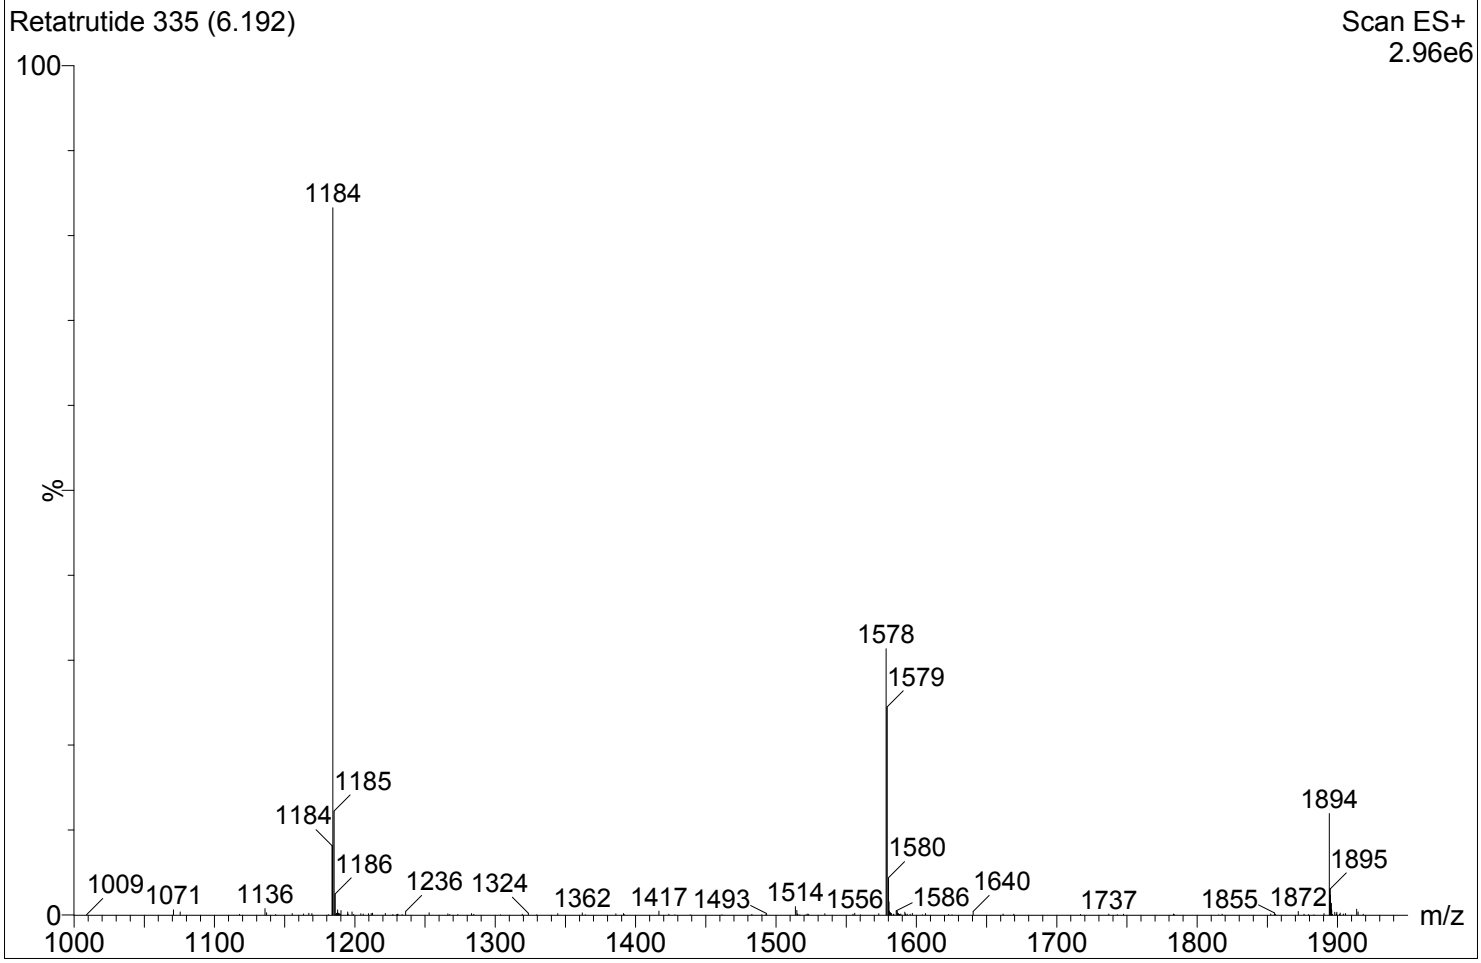
Retatrutide 335 (6.192)
Scan ES+
2.96e6
100
%
0
1184
1578
1579
1185
1184
1894
1580
1186
1895
1009
1071
1136
1236
1324
1362
1417
1493
1514
1556
1586
1640
1737
1855
1872
1000
1100
1200
1300
1400
1500
1600
1700
1800
1900
m/z