Righteous Research

PO Box 582
Kahului, HI 96733

**COC#** 145948
**Lab #** 214917
**Date Rec'd** 9/29/2026
**Report Issued** 10/8/2026

# Certificate of Analysis




**Project**
**Compound** Tirzepatide
**Label Claim** 15 mg
**Batch/Lot** SQ09082026

| Analyte | Result | Units | LOQ | % of Label | Method | Date | CAS |
|---|---|---|---|---|---|---|---|
| **Peptides & Bioactives** | | | | | | | |
| Chromatographic purity | >99.9 | % | 1 | | HPLC-UV/MS | 10/2/2026 | |
| Tirzepatide | 16.5 | mg | .1 | 109.8 | HPLC-UV-MS | 10/2/2026 | 2023788-19-2 |
| Mass Spectral Match | ID Confirmed | | | | HPLC-UV-MS | 10/2/2026 | |

The data presented are from the analysis of the sample shown and meet Krause Analytical internal quality assurance criteria unless otherwise flagged.
Data is not for regulatory compliance nor diagnostic use.
Methods shown reference current Krause Analytical SOPs
ND - Not detected LOQ - limit of quantification
OCH - above calibrated range OCL - below calibrated range
All values reported on a per vial basis unless otherwise noted
Copyright © 2026 Krause Analytical LLC. All rights reserved.


Respectfully submitted,


Mark C. Krause
Laboratory Director

**********

CHROMATOGRAM

**********

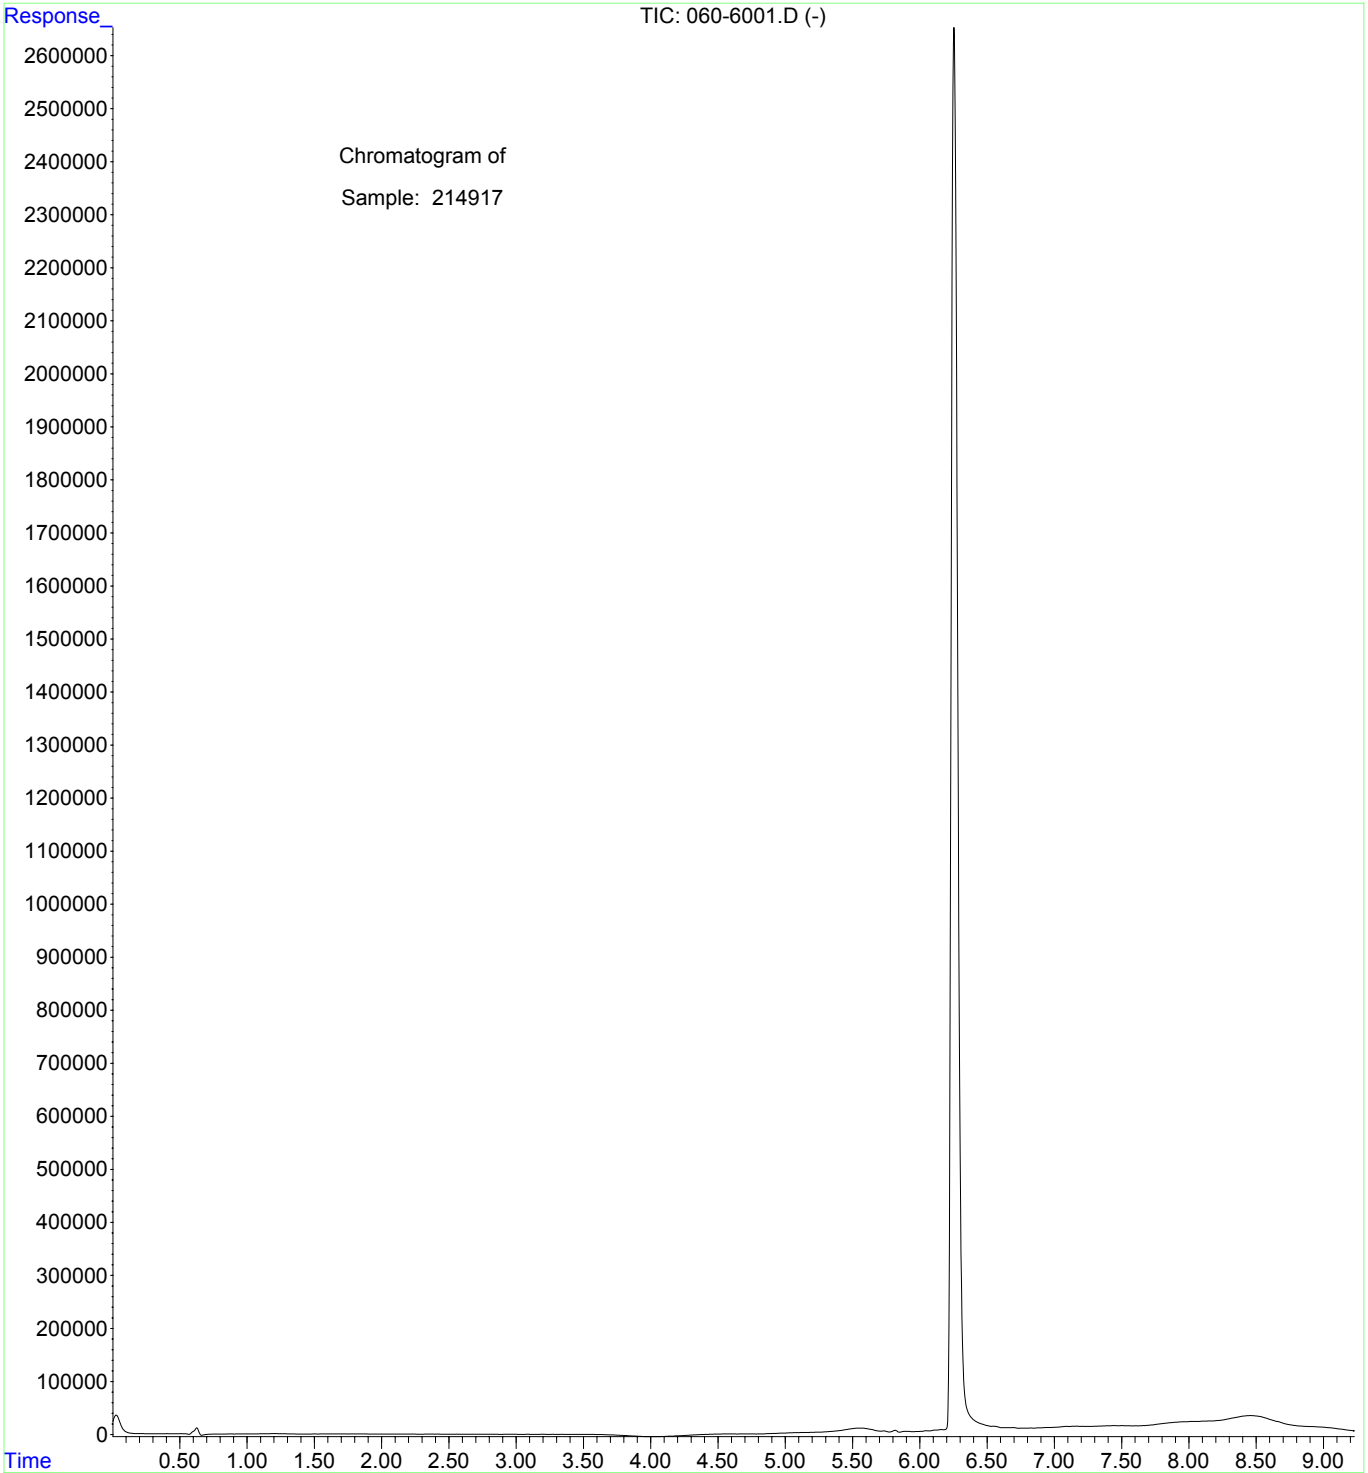

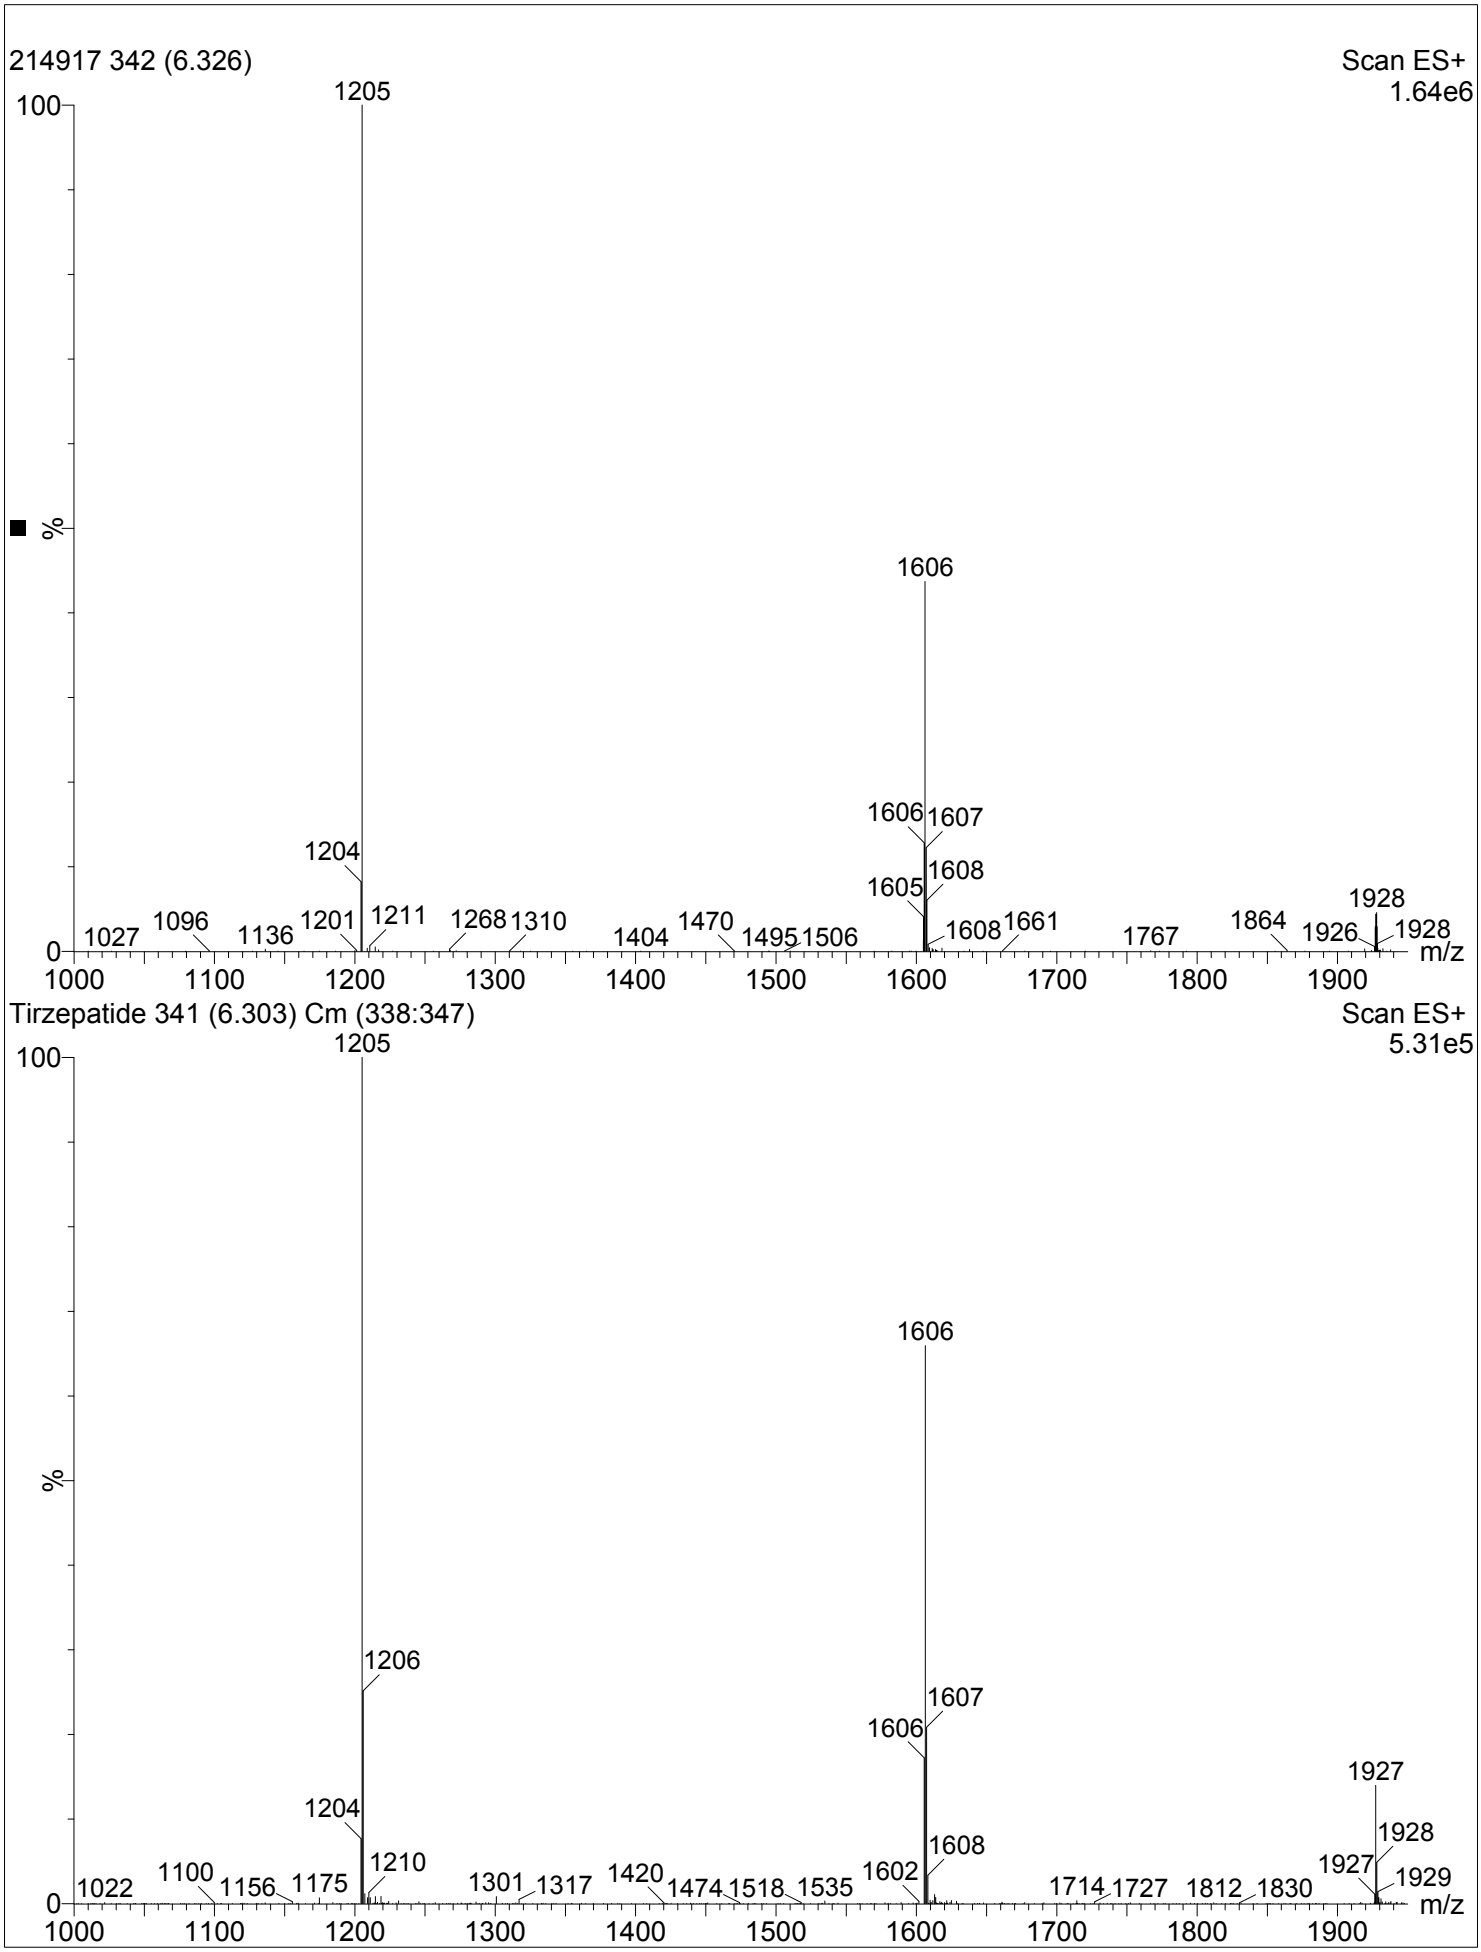
214917 342 (6.326)
Scan ES+
1.64e6
100
%
0
1205
1606
1606
1607
1204
1608
1605
1928
1027
1096
1136
1201
1211
1268
1310
1404
1470
1495
1506
1608
1661
1767
1864
1926
1928
m/z
1000
1100
1200
1300
1400
1500
1600
1700
1800
1900
Tirzepatide 341 (6.303) Cm (338:347)
Scan ES+
5.31e5
100
%
0
1205
1606
1206
1607
1606
1927
1204
1928
1608
1927
1210
1929
1022
1100
1156
1175
1301
1317
1420
1474
1518
1535
1602
1714
1727
1812
1830
m/z
1000
1100
1200
1300
1400
1500
1600
1700
1800
1900